



## AREA IMPIANTI FOR INDUSTRIAL CONSORTIUM OF MAGOMER

Shop number: 5005 – Construction year: 2018

### MAIN TECHNICAL DATA:

<b>Boiler</b>	
Circulation	Natural
Steam flow	34 t/h
Operating pressure	49 barg
Inlet water pressure	130 °C
Outlet steam temperature	410 °C
Outlet gas temperature	200 °C
Recovered heat	26 MW
Cleaning system	Hammers

<b>Heat Source</b>	
Grate	Tecnologia Noell
City waste troughput	22 kg/s
Heat supplied	1150 °C
Gas flow	300 kg/h
Gas temperature	30 MW

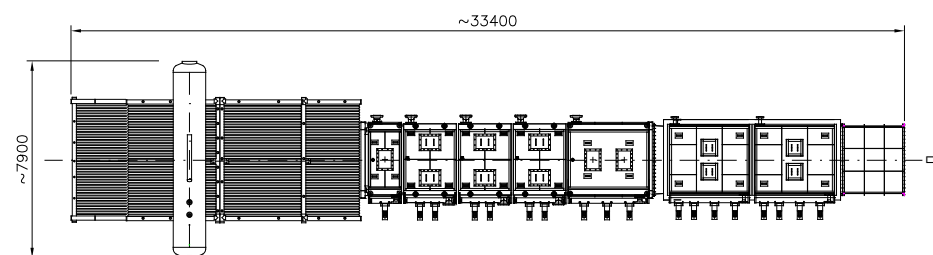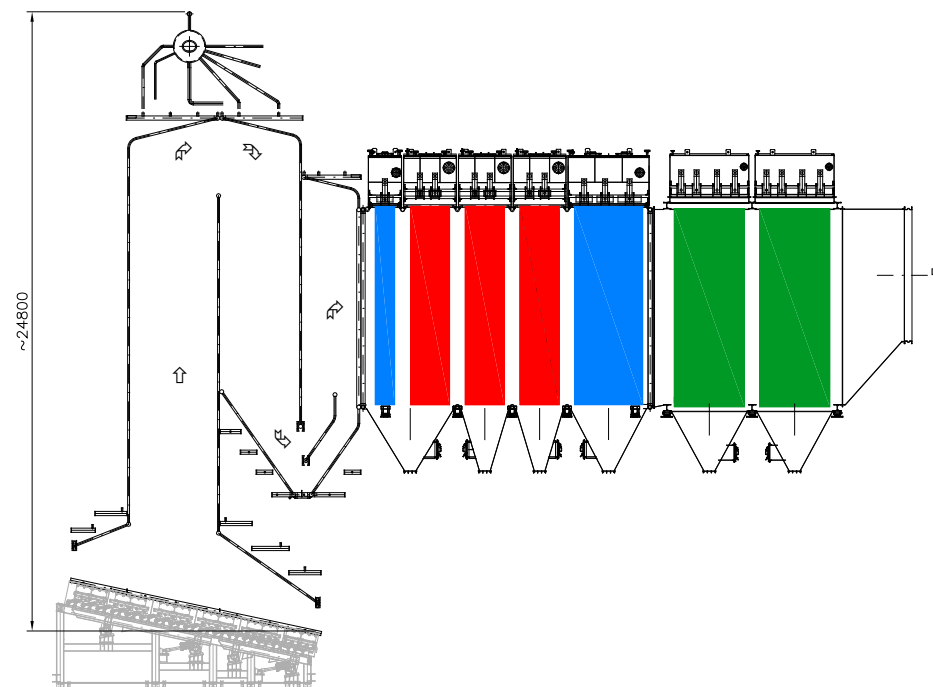

LEGENDA:

■ ECONOMIZER    
 ■ SUPERHEATER    
 ■ EVAPORIZER