

REFUSES' LAZIO CONSORCIO IN MALAGROTTA (ROMA)

Shop number: 4690 – Erection year: 2009

MAIN TECHNICAL DATA:

High Pressure Boiler


Steam flow	55 t/h
Operating pressure	55 barg
Inlet water temperature	135 °C
Outlet steam temperature	410 °C
Inlet gas temperature	590 °C
Outlet gas temperature	220 °C
Recovered heat	40 MW

Low Pressure Boiler

Steam flow	6 t/h
Operating pressure	5 barg
Inlet water temperature	135 °C
Outlet steam temperature	159 °C
Outlet gas temperature	190 °C
Recovered heat	4 MW

Heat Source

Gas turbine	G. E. LM2500
Gas flow	97 kg/s
Gas temperature	480 °C

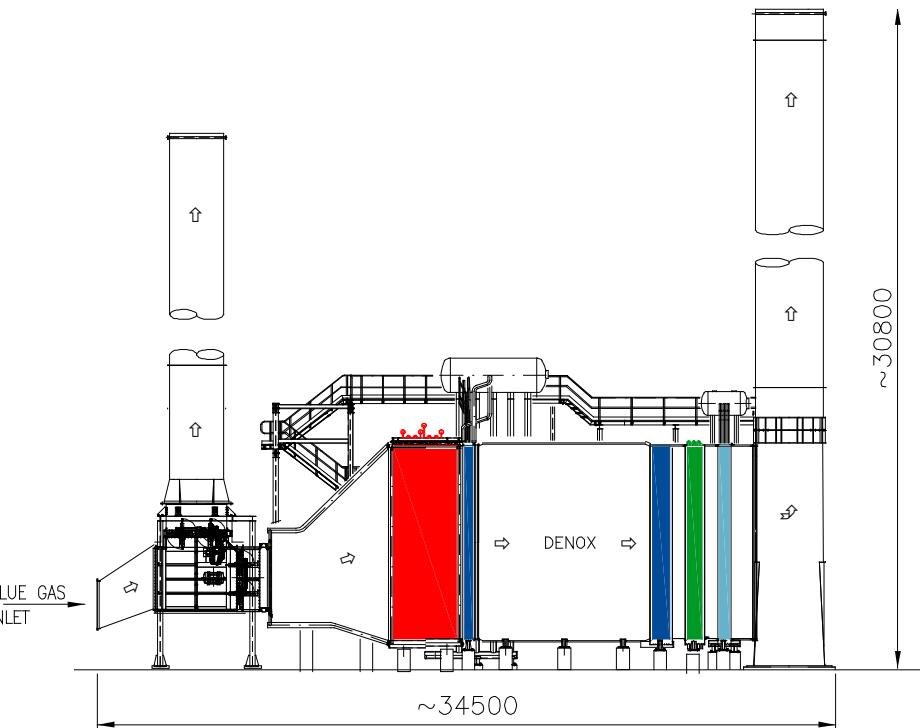

LEGENDA:

- ECONOMIZER
- SUPERHEATER
- EVAPORIZER H.P.
- EVAPORIZER L.P.

